



**EMC Test Report**  
**For**  
**Power and Energy Meter**

**AIWAA SYSTEMS PVT LTD**

**ULR – TC1200124000000172F**

**Test Report No.: CCTL/EMC/TRP/CML/2425/ 210**



*This report shall not be reproduced without the written approval of Cosmic Compliance Test Lab. The test results stated in this report are valid only for the specific item tested under specific conditions and applied to the sample as received limited to the parameters monitored during the conduction of the test.*

**For any Complaints / Suggestions please email to**

**[emc@cosmictestlab.com](mailto:emc@cosmictestlab.com)**

**Submitted by**

**Cosmic Compliance Test Lab**

**A-1, Sy No 192/1, III Phase Bommasandra,**

**Bengaluru - 560099.**



## Amendment History:

Revision No.	Date of Amend.	Amendment made	Reasons	Approved by
-NA-	-NA-	-NA-	-NA-	-NA-

## Laboratory Accreditation Details:

The accreditation details in the below table.

Accreditation Bodies	Certificate Number
National Accreditation Board for Testing and Calibration Laboratories (NABL) as per ISO/IEC 17025:2017 Agreement for use of NABL Accredited CAB combined ILAC MRA Mark	TC-12001



## General acronyms for the report

<b>EMC</b>	Electro Magnetic Compatibility
<b>EMI</b>	Electro Magnetic Interference
<b>ESD</b>	Electro Static Discharge
<b>BCI</b>	Bulk Current Injection
<b>NA</b>	Not Applicable
<b>EUT</b>	Equipment Under Test
<b>ISO</b>	International Organization for Standardization
<b>CISPR</b>	International Special Committee on Radio Interference
<b>AMN</b>	Artificial Mains Network
<b>S / Sec</b>	second
<b>min</b>	minute
<b>h, hrs</b>	hours
<b>Hz</b>	Hertz
<b>dB</b>	Decibel
<b>VSWR</b>	Voltage Standing Wave Ratio
<b>RBW</b>	Resolution Bandwidth
<b>VBW</b>	Video Bandwidth
<b>CW</b>	Continuous Wave
<b>AM</b>	Amplitude Modulation
<b>CCC</b>	Capacitive Coupling Clamp
<b>ICC</b>	Inductive Coupling Clamp
<b>DCC</b>	Direct Capacitive Coupling
<b>GRP</b>	Ground Reference Plane
<b>HCP</b>	Horizontal Coupling Plane
<b>VCP</b>	Vertical Coupling Plane
<b>CAN</b>	Controlled Area Network
<b>NB</b>	Narrowband
<b>BB</b>	Broadband
<b>ESA</b>	Electrical / Electronic Sub Assembly
<b>mA</b>	milli Ampere
<b>V/m</b>	Volts / meter



## Table of Contents

TABLE OF CONTENTS .....	4
LIST OF FIGURES .....	5
LIST OF TEST GRAPHS .....	5
LIST OF TABLES.....	6
1. GENERAL INFORMATION.....	7
2. TEST RESULT SUMMARY: .....	8
2.1 TEST PERFORMED IN SUBCONTRACT LAB: .....	9
2.2 MEASUREMENT UNCERTAINTY .....	9
2.3 OPINIONS & INTERPRETATION.....	9
2.4 DEVIATION FROM STANDARD.....	9
3. EQUIPMENT UNDER TEST INFORMATION.....	10
3.1 DESCRIPTION OF EUT .....	10
3.2 ACCESSORIES DETAILS .....	12
4. PERFORMANCE MONITORING PARAMETERS.....	12
5. TEST REQUIREMENTS.....	13
ANNEXURE A: RADIATED EMISSION TEST (RE).....	13
ANNEXURE B: ELECTRO STATIC DISCHARGE TEST (ESD).....	22
ANNEXURE C: RADIATED IMMUNITY TEST (RI).....	26
ANNEXURE D: ELECTRICAL FAST TRANSIENT TEST (EFT) .....	31
ANNEXURE E: SURGE TEST .....	34
ANNEXURE F: CONDUCTED SUSCEPTIBILITY TEST (CS).....	37
ANNEXURE G: POWER FREQUENCY MAGNETIC FIELD TEST .....	40
ANNEXURE H: VOLTAGE DIPS AND SHORT INTERRUPTIONS TEST.....	44



## List of Figures

Figure 1: Equipment Under test Photo .....	11
Figure 2: Marking Label of EUT .....	11
Figure 3: Radiated Emission Test Setup .....	17
Figure 4: Test Setup Photos .....	21
Figure 5: ESD Test Setup .....	23
Figure 6: Test Setup Photos .....	25
Figure 7: Radiated immunity Test Setup .....	28
Figure 8: RI_80MHz to 1GHz_VP .....	29
Figure 9: RI_80MHz to 1GHz_HP .....	29
Figure 10: RI_1GHz to 2.7GHz_VP .....	30
Figure 11: RI_1GHz to 2.7GHz_HP .....	30
Figure 12: Electrical Fast Transient Test Setup .....	32
Figure 13: Test Setup Photos .....	33
Figure 14: Surge immunity Test Setup .....	35
Figure 15: Test Setup Photos .....	36
Figure 16: Conducted Immunity Test Setup .....	38
Figure 17: Test Setup Photos .....	39
Figure 18: PFMF Test Setup .....	41
Figure 19: Test Setup Photos .....	43
Figure 20: Voltage Dips and Short Interruption Test Setup .....	45
Figure 21: Test Setup Photos .....	47

## List of Test Graphs

Graph 1: RE_ 30 MHz to 1 GHz- Ambient .....	18
Graph 2: RE_ 30 MHz to 1 GHz-Vertical .....	18
Graph 3: RE_ 30 MHz to 1 GHz_ Horizontal .....	19



## List of Tables




Table 1: RE_ 30 MHz to 1 GHz_ Vertical .....	19
Table 2: RE_ 30 MHz to 1 GHz_ Horizontal .....	20
Table 3: ESD Test Results .....	24
Table 4: Radiated immunity Test Results .....	29
Table 5: Electrical Fast Transient Test Results .....	33
Table 6: Surge immunity Test Results .....	36
Table 7: PFMF Test Results .....	42
Table 8: Voltage Dips and Short Interruption Test Results .....	46



## 1. General Information

Name of the Applicant	AIWAA SYSTEMS PVT LTD
Contact Name	Mr. Vamsi Krishna V
Contact No	+91-9036755571
Email id	vamsireddy@aiwaasystems.com
EUT Manufacturer Name and Address	AIWAA SYSTEMS PVT LTD No 109, 2 Floor, BTM 4 Stage 80 Feet Road, Bangalore, Bengaluru (Bangalore) Urban, Karnataka, Bangalore Karnataka, 560076
EUT Name	Power and Energy Meter
Model No	PEA2488
Serial No	2400000063
Name of the Laboratory	Cosmic Compliance Test Lab. Pvt. Ltd.
Laboratory Address	SyNo.192/1, A-1, Munireddy Industrial Estate, 3rd Phase, Bommasandra, Bangalore - 560099
Tests Conducted	<a href="#">Refer test summary.</a>
Test Standard	<a href="#">Refer test summary.</a>
Status of EUT on receipt	EUT was received in Good Condition.
EUT Received on	16-09-2024
Test Report Issued on	03-01-2025
Test witnessed by	Mr. Vamsi Krishna V
Test Result	<a href="#">Refer test summary.</a>
Statement of conformity	Declaration of conformity of the results is based as per the standard limits.
Report prepared by	Sreeyesh T Sreedhar

### Test Engineer and Reviewer Details

<p>Tested by</p>  <p>Mr. Jayanth SS Test Engineer</p>	<p>Reviewed by</p>  <p>Mr. Anil R Lab in Charge</p>	<p>Authorized by</p>  <p>Mrs. Senthamarai R Technical Manager</p>
--	--	--

**Note:** This report is digitally signed by the approving authority through a secured workflow



## 2. Test result summary:

Annexure	Test Carried Out	Standard Number	Test Date	Test Result	Remarks
EMISSION TESTS					
<a href="#">Annexure A</a>	Radiated Emission Test	CISPR 11	03-10-2024	PASS	-
IMMUNITY TESTS					
<a href="#">Annexure B</a>	Electro Static Discharge Test	IEC 61000-4-2	16-09-2024	PASS	-
<a href="#">Annexure C</a>	Radiated Immunity Test	IEC 61000-4-3	17-09-2024	PASS	-
<a href="#">Annexure D</a>	Electrical Fast Transient Test	IEC 61000-4-4	16-09-2024	PASS	-
<a href="#">Annexure E</a>	Surge Test	IEC 61000-4-5	18-09-2024	PASS	-
<a href="#">Annexure F</a>	Conducted Susceptibility Test	IEC 61000-4-6	16-09-2024	PASS	-
<a href="#">Annexure G</a>	Power Frequency Magnetic Field	IEC 61000-4-8	16-09-2024	PASS	-
<a href="#">Annexure H</a>	Voltage Dips & Short Interruption Test	IEC 61000-4-11	16-09-2024	PASS	-

**Conclusion:** All indications of PASS/FAIL in this report are opinion expressed by test laboratory based on interpretations and/or observations of test results. Please refer individual annexures for detailed test results/observations.

**Remarks:** Additional remarks if any





## 2.1 Test performed in subcontract lab:

Annexure	Test carried out	Test date	Result / Observation	Remarks
N/A	N/A	N/A	N/A	N/A

## 2.2 Measurement uncertainty

The following common measurement uncertainties are applicable to the relevant tests that are mentioned below:

Test	Uncertainty (±)	
Commercial		
Conducted Emission	9kHz-150kHz	± 2.92 dB
	150kHz-30MHz	± 3.00 dB
Radiated Emission	30MHz-1GHz	± 4.26 dB
	1GHz-18GHz	± 5.54 dB

## 2.3 Opinions & interpretation

None

## 2.4 Deviation from Standard

None



## 3. Equipment Under Test Information

<b>Equipment Name:</b>		Power and Energy meter
<b>Make:</b>		AIWAA SYSTEMS PVT LTD
<b>Model No. / Part No.:</b>		PEA2488
<b>Serial No.:</b>		2400000063
<b>Input Rating</b>	<b>Power, P:</b>	< 8 VA
	<b>Voltage, V:</b>	80 – 277 VLN AC / 100 – 277 VDC
<b>Type of Equipment:</b>		<input type="checkbox"/> Floor standing <input checked="" type="checkbox"/> Table top <input type="checkbox"/> Wall mount or Fixed equipment
<b>Accessories:</b>		<input checked="" type="checkbox"/> Y / <input type="checkbox"/> N

### 3.1 Description of EUT

PEA24xx series LCD meters are Power and Energy meters with following features:  
 True RMS electrical parameters: phase wise voltage, current, demand, W, VA, VAR  
 Integrated parameters: KWh, VAh, VARh, timer and Counter  
 4 Quadrant energy: bi-directional, Total and net  
 Demand, Rate counters, Alarms  
 Maximum Minimum value  
 THD and Harmonics measurement up to 15<sup>th</sup> Order  
 RS485 with Modbus protocol  
 2 Digital Input  
 2 Digital Output  
 2 Relay Output

PEA2488 is superset model in PEA24xx series LCD meters

#### Applications

- Control Panes
- Power Distribution Panels
- Connection to Plant Monitoring & Control Systems
- Gen-set Panels
- Original Equipment Manufacturers (OEMs)
- Building Management System



Figure 1: Equipment Under test Photo

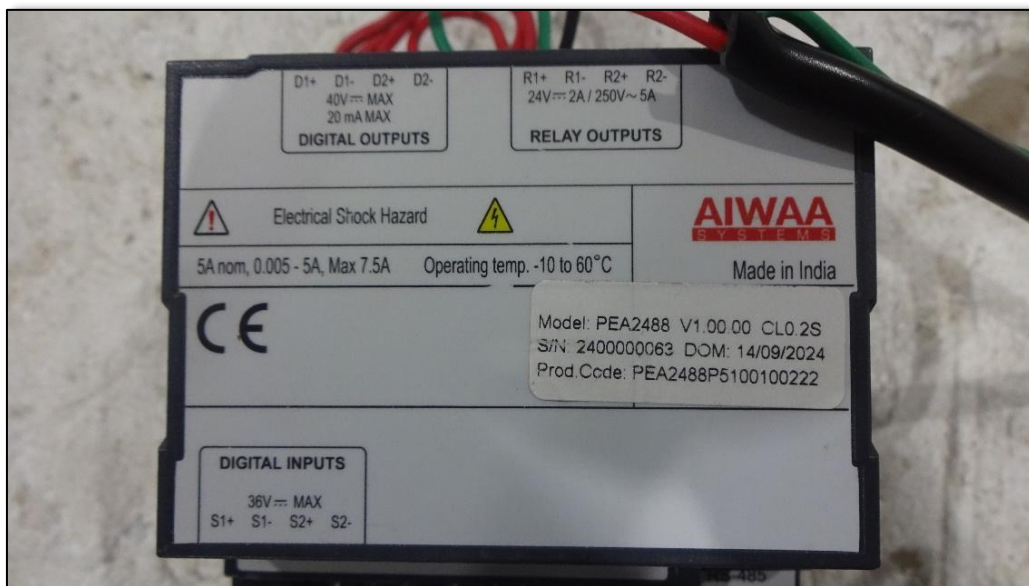


Figure 2: Marking Label of EUT



## 3.2 Accessories details

SI No.	Equipment	Brand	Model No.	Serial No.	Remarks, if any
1	NA	NA	NA	NA	NA

## 4. Performance Monitoring Parameters

For monitoring the continuous functionality of EUT,

- Observing the pinging is happening using communication equipment with Laptop

Observing the screen is having any kind of flickering or going complete OFF



## 5. Test requirements

### EMISSION TESTS

#### Annexure A: Radiated emission Test (RE)

##### Common information:

Test Date : 03-10-2024  
Temperature : 25° C  
Humidity : 50 % RH

##### Test Specification:

Reference Standard : CISPR 11: 2024  
Frequency Range : 30MHz to 1GHz  
Polarity of Antenna : Horizontal and Vertical  
Resolution Band Width : 120kHz / 1MHz  
Step size : Half of RBW  
Test Distance between  
Antenna and EUT : 3 m  
Antenna Height : 1 to 4 m



## Test Limits:

**Table A.2 – Requirements for radiated emissions at frequencies up to 1 GHz for class A equipment**

Table clause	Frequency range MHz	Measurement			Class A limits dB(μV/m)
		Facility (see Table A.1)	Distance m	Detector type / bandwidth	
A2.1	30 to 230	OATS/SAC	10	Quasi Peak / 120 kHz	40
	230 to 1 000				47
A2.2	30 to 230	OATS/SAC	3		50
	230 to 1 000				57
A2.3	30 to 230	FAR	10	Quasi Peak / 120 kHz	42 to 35
	230 to 1 000				42
A2.4	30 to 230	FAR	3		52 to 45
	230 to 1 000				52

Apply only A2.1 or A2.2 or A2.3 or A2.4 across the entire frequency range.

**Table 1 – Required highest frequency for radiated measurement**

Highest internal frequency ( $F_x$ )	Highest measured frequency
$F_x \leq 108$ MHz	1 GHz
$108 \text{ MHz} < F_x \leq 500$ MHz	2 GHz
$500 \text{ MHz} < F_x \leq 1$ GHz	5 GHz
$F_x > 1$ GHz	$5 \times F_x$ up to a maximum of 6 GHz

NOTE 1 For FM and TV broadcast receivers,  $F_x$  is determined from the highest frequency generated or used excluding the local oscillator and tuned frequencies.

NOTE 2  $F_x$  is defined in 3.1.18.

NOTE 3 For outdoor units of home satellite receiving systems highest measured frequency shall be 18 GHz.

Where  $F_x$  is unknown, the radiated emission measurements shall be performed up to 6 GHz.

## NOTE:

(1) The tighter limit applies at the band edges.

(2) Emission level (dBuV/m) = 20log Emission level (uV/m).

(3) The test result calculated as following:

Measurement Value = Reading Level + Correct Factor

Correct Factor = Antenna Factor + Cable Loss - Amplifier Gain (if use)

Margin Level = Measurement Value - Limit Value



## Test Equipment Used:

Sl. No.	Description	Make	Model No.	Serial No.	Cal Due
1.	Semi Anechoic Chamber	Tekiknow	TEK3MSAC	TTI3MSACCTL	12-05-2025
2.	EMI Receiver	Rohde-Schwarz	ESW44	101594	16-12-2024
3.	Pre amplifier	Compower	PAM118A	18040136	17-05-2025
4.	RF cable	Srinar communication	RG 144	CCTL/EMC/RFC/004	NA
5.	RF cable	Srinar communication	RG 144	CCTL/EMC/RFC/007	NA
6.	Combilog Antenna	COM-POWER	AC-220	10030074	05-01-2025

## REMARK:

(1) "N/A" denotes no model name, no serial no. or no calibration specified.



## Test Procedure:

The separation distance of 3 m was used for measurements up to 1 GHz. The EUT was placed on the top of a table 0.8 m above the rotating ground in a 3 m semi-anechoic chamber.


- Cables connecting to AE located outside the measurement area drop directly to, but be insulated from the RGP (or turntable where applicable), and then be routed directly to the place where they leave the test site. However, cables which would normally be bonded to ground should be bonded to the RGP in accordance with normal practice or the manufacturer's recommendation.
- The rotating ground was rotated 360 degrees to determine the position of the highest radiation.
- The height of the receive antenna was varied between 1 m and 4 m. Both horizontal and vertical Polarizations of the antenna were checked.
- For each suspected emission, the EUT was arranged at its worst case and then the antenna was scanned in height to find the maximum.
- The receiver was set to quasi-peak detect function and specified bandwidth with maximum hold mode.
- For the actual test configuration, please refer to the related Item - TEST PHOTOS.



## Test Setup:

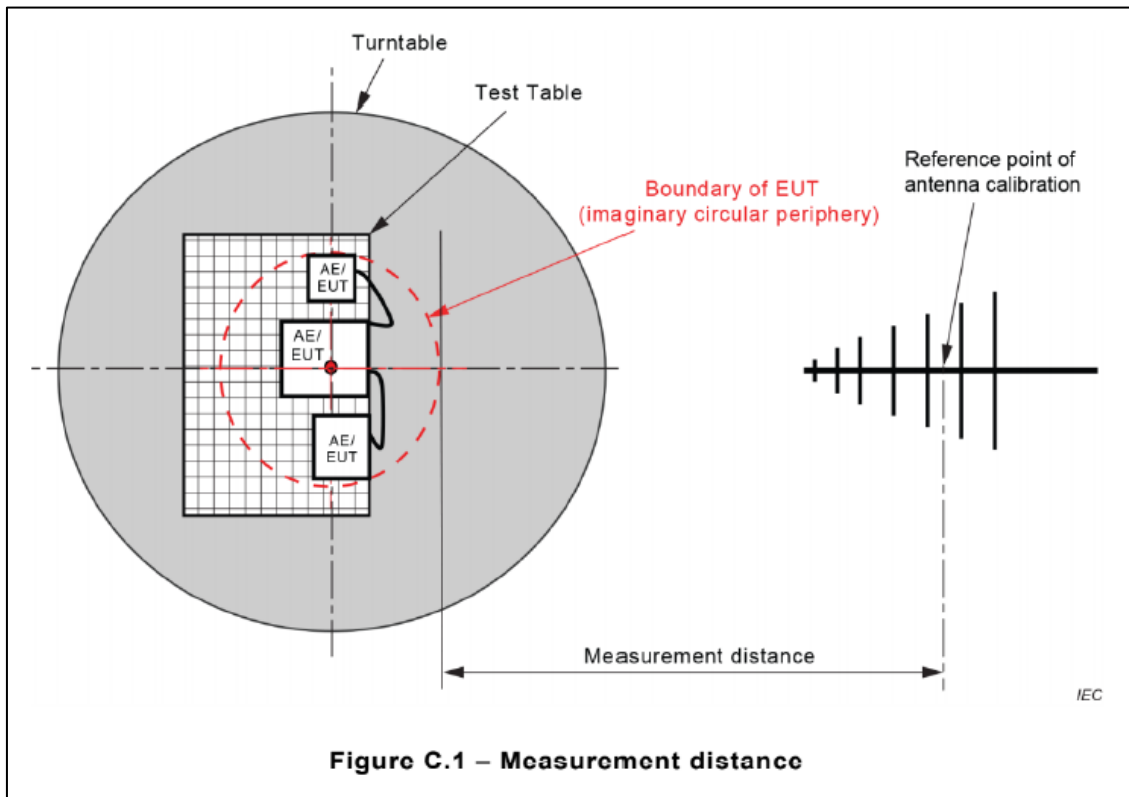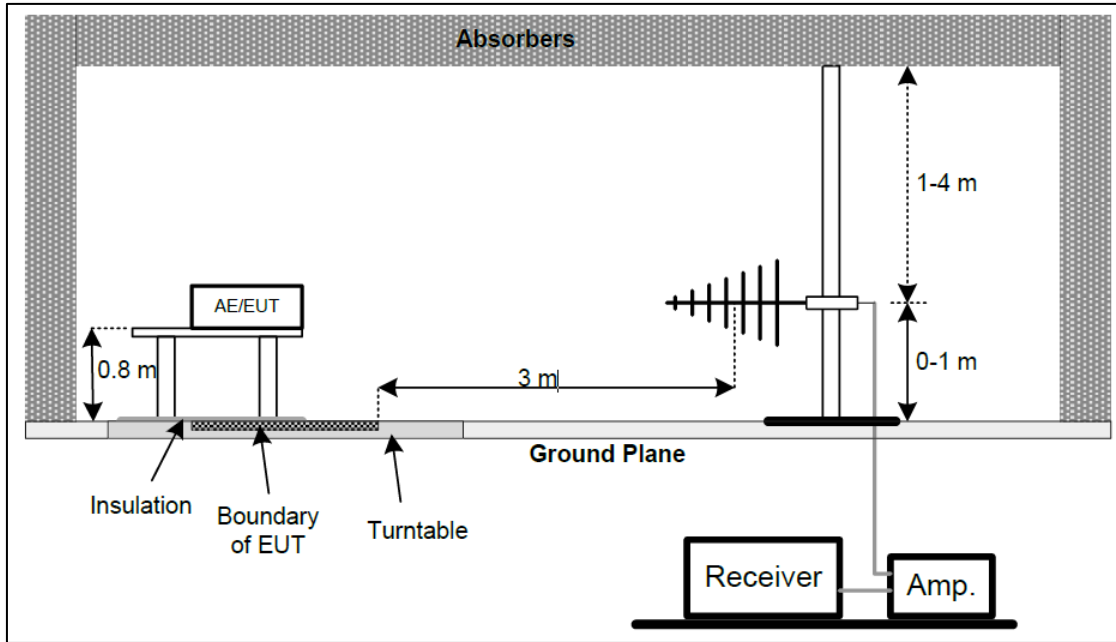




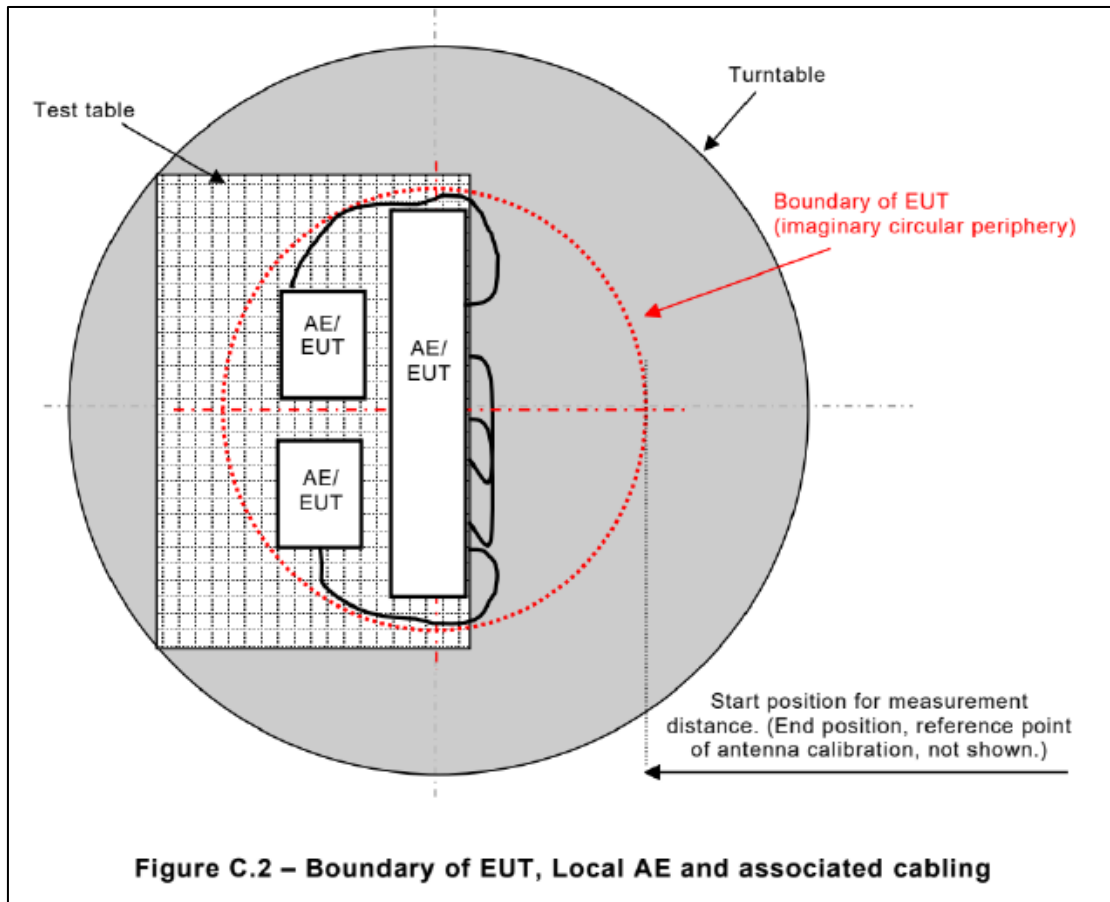


**Figure 3: Radiated Emission Test Setup**



## Test Graphs:

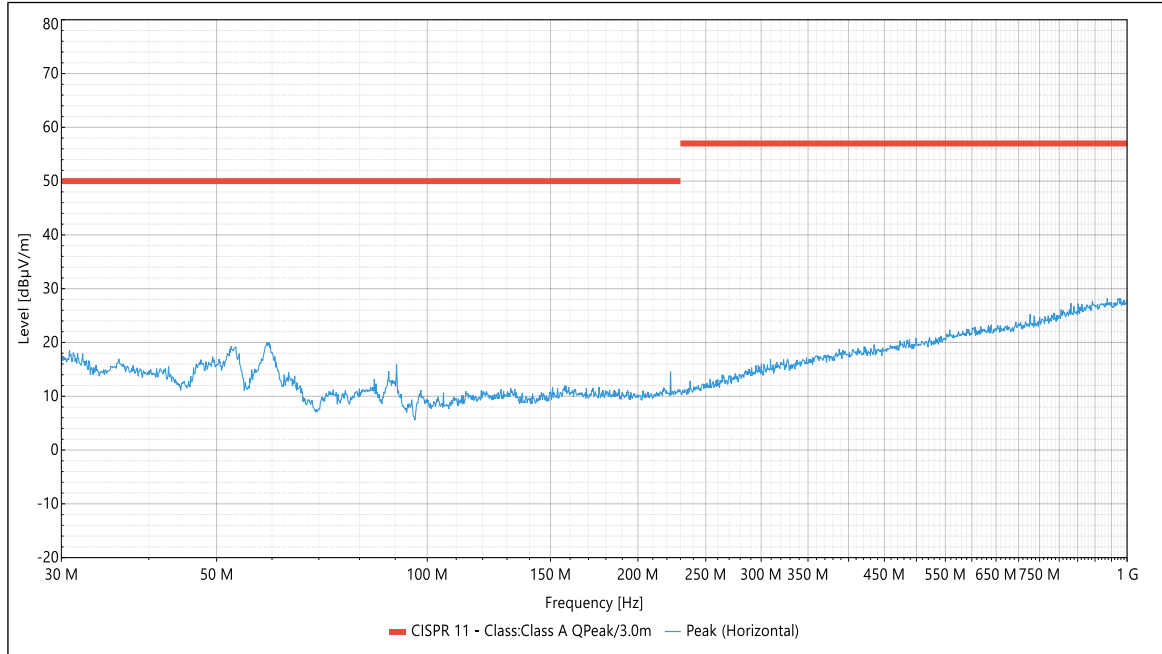

**Graph 1: RE\_ 30 MHz to 1 GHz- Ambient**

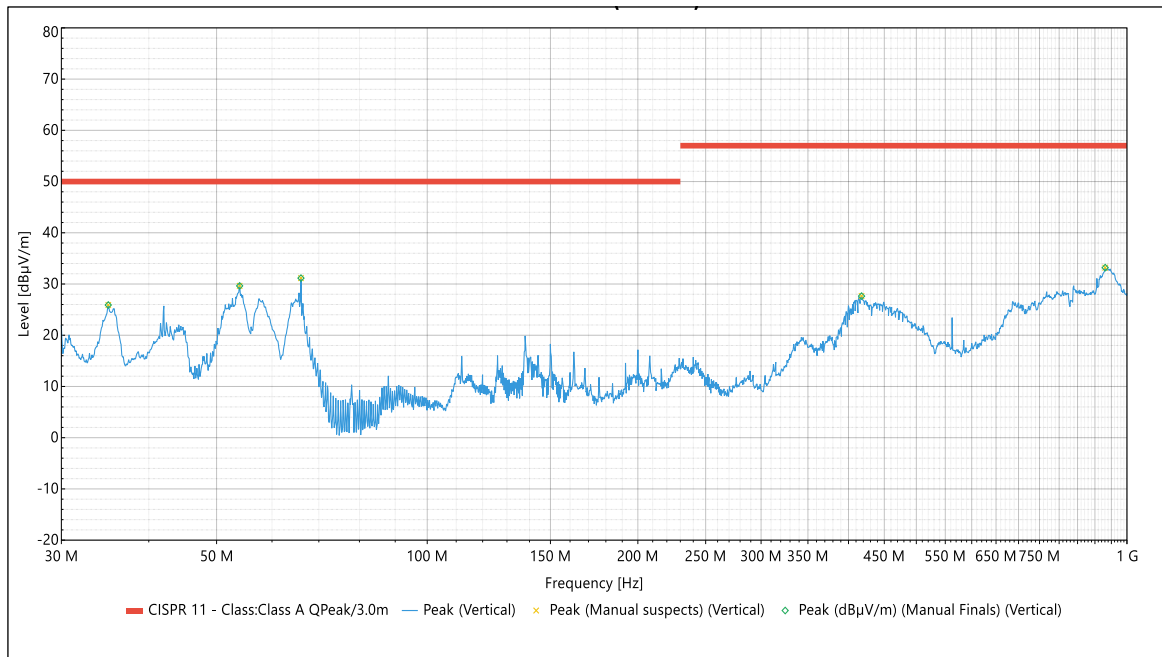


**Graph 2: RE\_ 30 MHz to 1 GHz-Vertical**



SI NO	Frequency	Peak (dB $\mu$ V)	Lim.Q-Peak (dB $\mu$ V)
1	35.01 MHz	25.90	50
2	53.94 MHz	29.63	50
3	66.00 MHz	31.15	50
4	417.57 MHz	27.64	57
5	930.9 MHz	33.19	57

Table 1: RE\_ 30 MHz to 1 GHz\_ Vertical

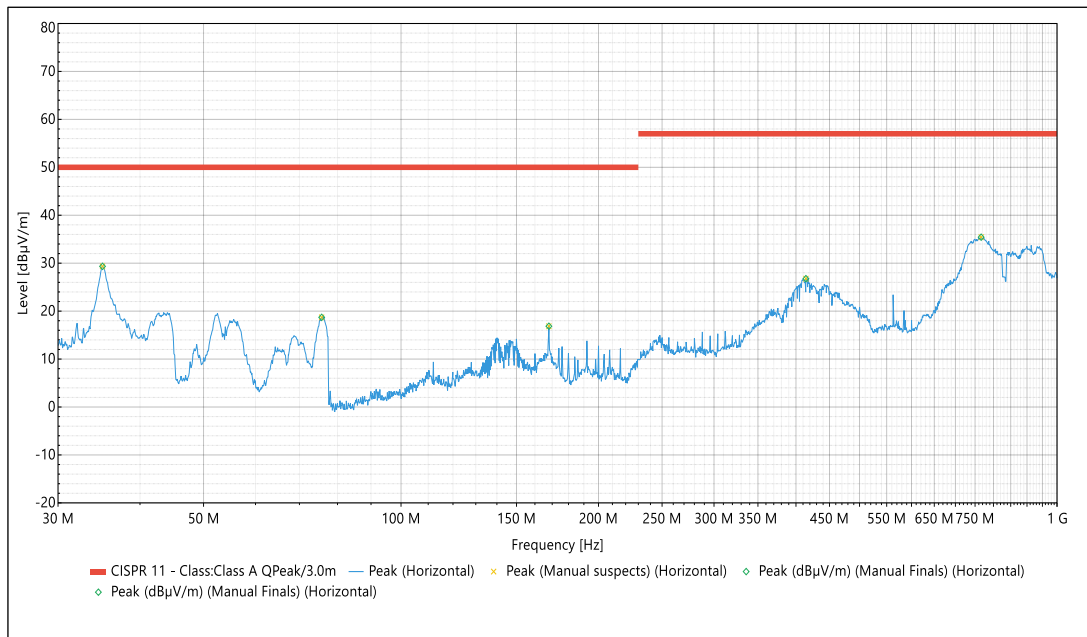

Graph 3: RE\_ 30 MHz to 1 GHz\_ Horizontal



SI NO	Frequency	Peak (dBμV)	Lim.Q-Peak (dBμV)
1	35.07 MHz	29.344	50
2	75.69 MHz	18.704	50
3	168.03 MHz	16.854	50
4	414.21 MHz	26.767	57
5	766.2 MHz	35.418	57

**Table 2: RE\_ 30 MHz to 1 GHz\_ Horizontal**

## Test Setup Photographs:



**RE\_ 30MHz to 1GHz\_ Vertical**



RE\_ 30MHz to 1GHz\_ Horizontal

Figure 4: Test Setup Photos

**Test Result: PASS**



## IMMUNITY TESTS

### Annexure B: Electro Static Discharge Test (ESD)

#### Common information:

Test Date : 16-09-2024  
Temperature : 22.5 ° C  
Humidity : 58 % RH  
Atmospheric Pressure : 910 mbar

#### Test Specification:

Reference Standard : IEC 61000-6-2:2016  
Test Standard : IEC 61000-4-2  
Discharge Network : 150pF (Charging capacitance), 330Ω (Discharging impedance)  
Polarity : Positive & Negative  
Number of discharges : 10 Pulses for Each Point  
Discharge Time : 1 s

#### Test Equipment Used:

Sl. No.	Description	Make	Model No.	Serial No.	Cal Due
1.	ESD Simulator	SHANGHAI SOSIN	RV ESD	SX33220916	05-01-2025
2.	Discharge Network	SHANGHAI SOSIN	EMCSOSIN	SX211222	05-01-2025

#### **REMARK:**


(1) "N/A" denotes no model name, no serial no. or no calibration specified.



## Test Procedure:

1. Contact discharge was applied to conductive surfaces of the EUT & Air discharge was applied only to non-conducted surfaces of the EUT.
2. Test performed as per table top test setup/ floor standing test setup. The table top EUT was placed on table at 0.8meter height. Floor standing EUT was placed on insulation at 0.1meter height from the ground reference plane (GRP).
3. The horizontal coupling plane (HCP),  $(1,6 \pm 0,02) \text{ m} \times (0,8 \pm 0,02) \text{ m}$ , was placed on the table & grounded to the GRP with two 470k  $\Omega$  resistor. The EUT and its cables were isolated from the coupling plane by an insulating support  $(0,5 \pm 0,05) \text{ mm}$  in thickness.
4. The vertical coupling plane (VCP),  $(0,5\text{m} \times 0,5) \text{ m}$  was grounded with two 470k $\Omega$  resistor to the ground reference plane.
5. For contact discharge, static charge directly injected on the metal contacts of the EUT. For air discharge, directly injected on the non-metallic part of the EUT.
6. For ungrounded product, a discharge cable with two 470k $\Omega$  resistances were used for discharging the static charge.
7. During the test performance of the EUT was monitored as per the criteria specified in the standard.

## Test Setup:

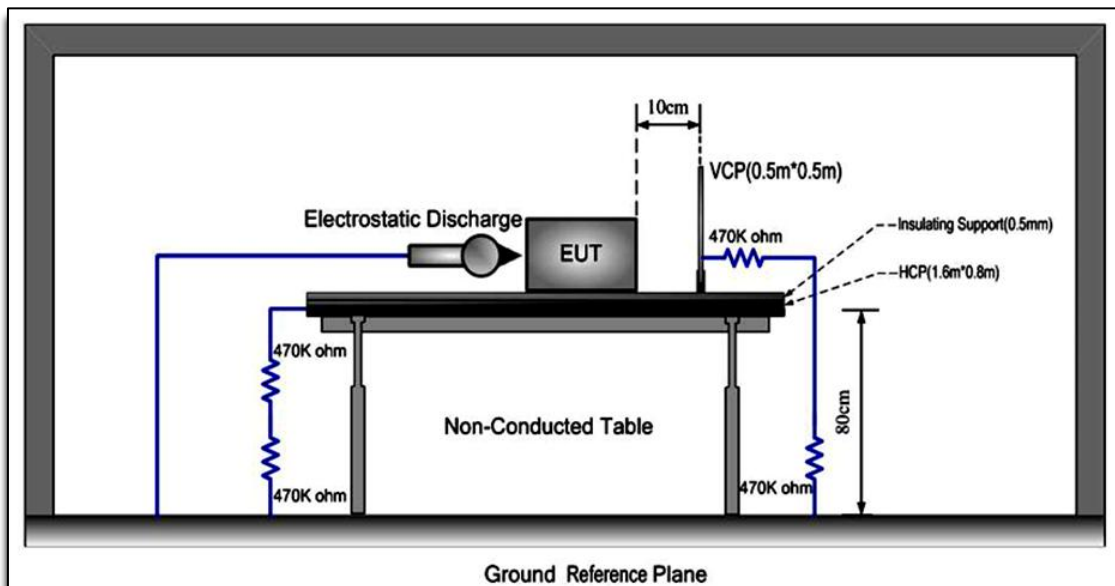

**Figure 5: ESD Test Setup**





## Test Results:

Indirect Discharge		Test Level, kV							
Sl. No	Test Points	+2	-2	+4	-4	+6	-6	+8	-8
1	HCP (Front)	A	A	A	A	A	A	A	A
2	HCP (Left)	A	A	A	A	A	A	A	A
3	HCP (Right)	A	A	A	A	A	A	A	A
4	HCP (Rear)	A	A	A	A	A	A	A	A
5	VCP (Front)	A	A	A	A	A	A	A	A
6	VCP (Left)	A	A	A	A	A	A	A	A
7	VCP (Right)	A	A	A	A	A	A	A	A
8	VCP (Rear)	A	A	A	A	A	A	A	A


Air Discharge		Test Level, kV							
Sl. No	Test Points	+2	-2	+4	-4	+8	-8	+15	-15
1	Display	A	A	A	A	A	A	A	A
2	Switch	A	A	A	A	A	A	A	A
3	Cables	A	A	A	A	A	A	A	A
4	Connectors	A	A	A	A	A	A	A	A

Table 3: ESD Test Results






## Test Setup Photographs:

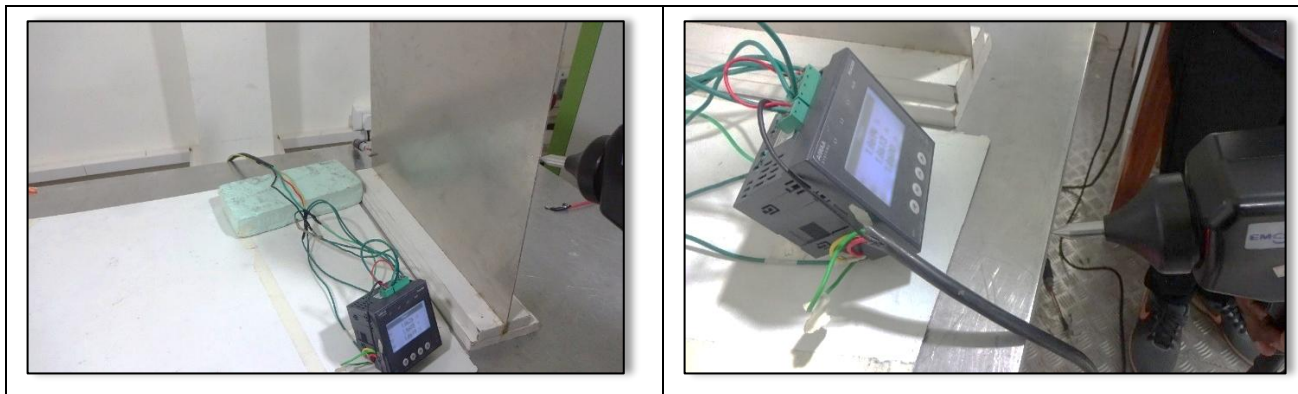

**Indirect Discharge on VCP and HCP Test Setup Photos**

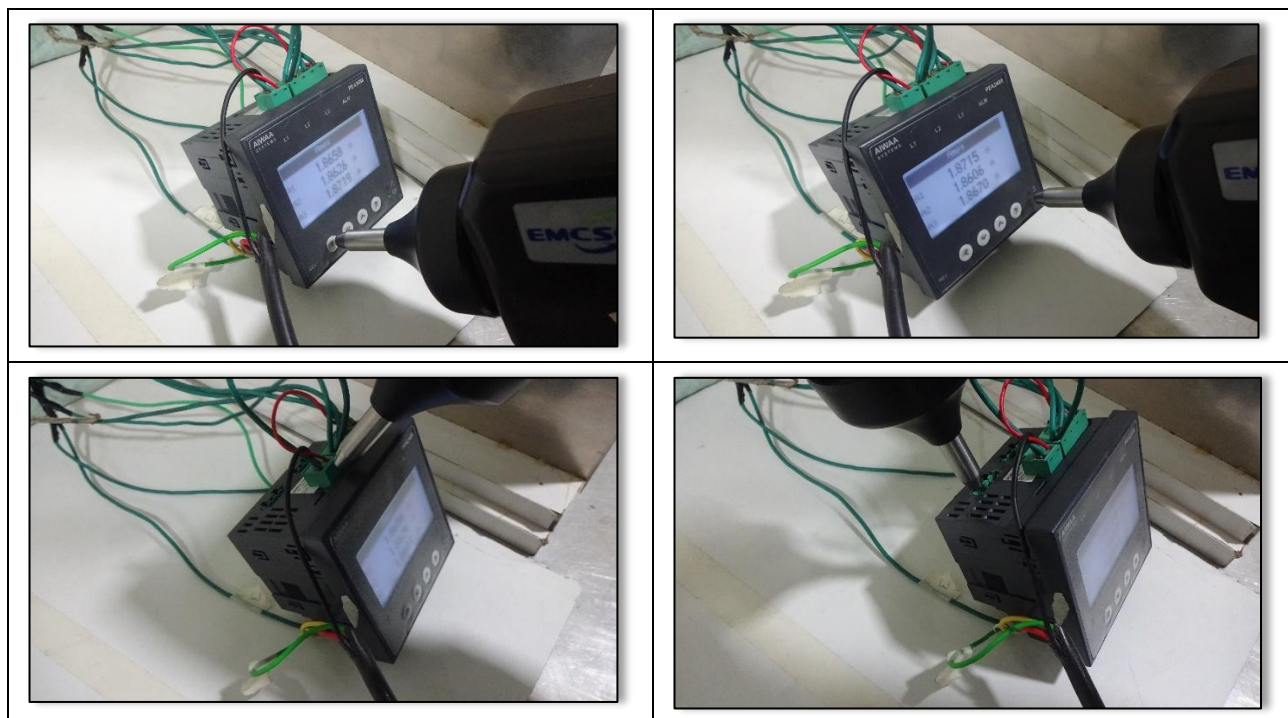

**Air Discharge on EUT Test Setup Photos**

**Figure 6: Test Setup Photos**

**Test Result: PASS**



## Annexure C: Radiated Immunity Test (RI)

### Common information:

Test Date : 03-10-2024  
Temperature : 24.8 ° C  
Humidity : 55.6 % RH

### Test Specification:

Reference Standard : IEC 61000-6-2:2016  
Test Standard : IEC 61000-4-3  
Frequency Range : 80MHz to 2.7GHz  
Modulation : 1kHz Sine Wave, 80 %, AM Modulation  
Frequency Step : 1 % of fundamental  
Polarity of Antenna : Horizontal and Vertical  
Test Distance : 3 m  
Antenna Height : 1.55 m  
Dwell Time : 3 s



## Test Equipment Used:

Sl. No.	Description	Make	Model No.	Serial No.	Cal Due
1.	Semi Anechoic Chamber	Tekiknow	TEK3MSAC	TTI3MSACCTL	12-05-2025
2.	RF Cable	Srinar communication	RG 144	CCTL/EMC/RFC/004	NA
3.	RF Cable	Srinar communication	RG 144	CCTL/EMC/RFC/007	NA
4.	Signal Generator	Rohde-Schwarz	SMB100A	182922	17-05-2026
5.	Power Amplifier (80MHz-1GHz)	Rohde-Schwarz	BBA150	104792	NA
6.	Power Amplifier (1GHz-6GHz)	amplifier research	75S1G6C	0361107	NA
7.	Log Periodic Antenna (80MHz-1GHz)	Amplifier research	ATL80M1G	361058	NA
8.	Horn Antenna (1GHz-6GHz)	Amplifier research	ATH800M6G	360721	NA

### REMARK:

(1) "N/A" denotes no model name, no serial no. or no calibration specified.



## Test Procedure:

The testing was performed in a fully-anechoic chamber.


The testing distance from antenna to the EUT was 3 m.

The EUT and support equipment are installed in a representative system as described in EN IEC 61000-4-3 was placed on a non-conductive table 0.8 m in height. The system under test was connected to the power and signal wire according to relevant installation instructions.

The other condition as following manner:

- A. The field strength is 3 V/m (unmodulated, rms).
- B. The frequency range is swept from 80 MHz to 1000 MHz with the signal 80 % amplitude modulated with a 1kHz sine wave. The rate of sweep did not exceed  $1.5 \times 10^{-3}$  decade/s. Where the frequency range is swept incrementally, the step size was 1 % of fundamental.
- C. The dwell time at each frequency shall be not less than the time necessary for the EUT to be able to respond.
- D. The test was performed with the EUT exposed to both vertically and horizontally polarized fields on each of the four sides.

## Test Setup:

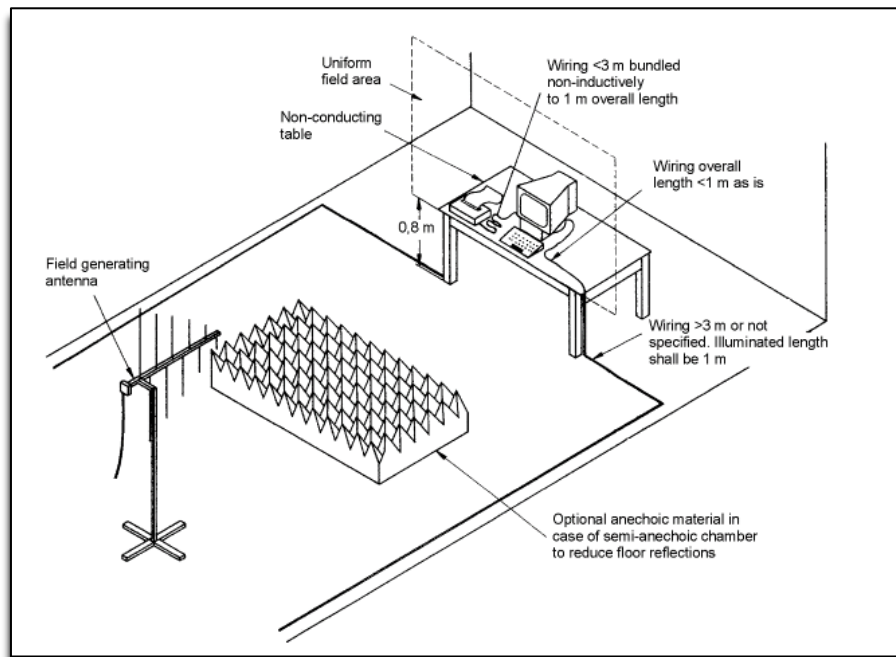

**Figure 7: Radiated immunity Test Setup**



## Test Results:

Frequency (MHz)	Applied Voltage(V/m) – 80% AM 1kHz	Polarity	Azimuth	Criterion	Observation	Result
80MHz to 1GHz	10 V/m	V & H	Front	Criteria A	No degradation occurred	<b>PASS</b>
			Rear			
1.4GHz to 2GHz	3 V/m	V & H	Front	Criteria A	No degradation occurred	<b>PASS</b>
			Rear			
2GHz to 2.7GHz	1 V/m	V & H	Front	Criteria A	No degradation occurred	<b>PASS</b>
			Rear			

**Table 4: Radiated immunity Test Results**

## Test Setup Photographs:




**Figure 8: RI\_80MHz to 1GHz\_VP**



**Figure 9: RI\_80MHz to 1GHz\_HP**



**Figure 10: RI\_1GHz to 2.7GHz\_VP**

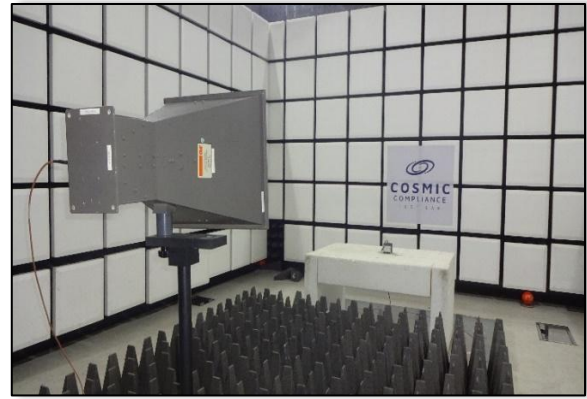

**Figure 11: RI\_1GHz to 2.7GHz\_HP**

**Test Result: PASS**





## Annexure D: Electrical Fast Transient Test (EFT)

### Common information:

Test Date : 16-09-2024  
Temperature : 25.8 ° C  
Humidity : 57.9 % RH

### Test Specification:

Reference Standard : IEC 61000-6-2:2016  
Test Standard : IEC 61000-4-4: 2012; Ed3.0  
Type of pulse : 5/50 ns  
Burst duration : 15ms  
Burst Period : 300ms  
Test Duration : At least 60sec  
Repetition frequency rate : 5kHz

### Test Equipment Used:

Sl. No.	Description	Make	Model No.	Serial No.	Cal Due
1.	EFT GENERATOR	SHANGHAI SOSIN	EFT T6	SX272104B4	05-06-2025

### **REMARK:**


(1) "N/A" denotes no model name, no serial no. or no calibration specified.



## Test Procedure:

1. The tabletop EUT was placed on table at 0.8meter height with the help of 0.1m insulation, Floor standing EUT was placed on insulation at 0.1meter height.
2. The distance between the EUT and any other metallic surface except the GRP was greater than 0.5m.
3. The length of the power cable and signal cable maintained 0.5m, the excess length of this cable was folded to avoid a flat coil and placed at distance of 0.1m above the GRP.
4. Test performed with 60 seconds duration for both power line and signal line.
5. If the EUT contains identical ports, test shall be performed for one port (example; 50 pair telecommunication cable). Test is not applicable for signal line, If the cable length is less than 3 m.
6. During the test performance of the EUT was monitored as per the criteria specified in the standard.

## Test Setup:

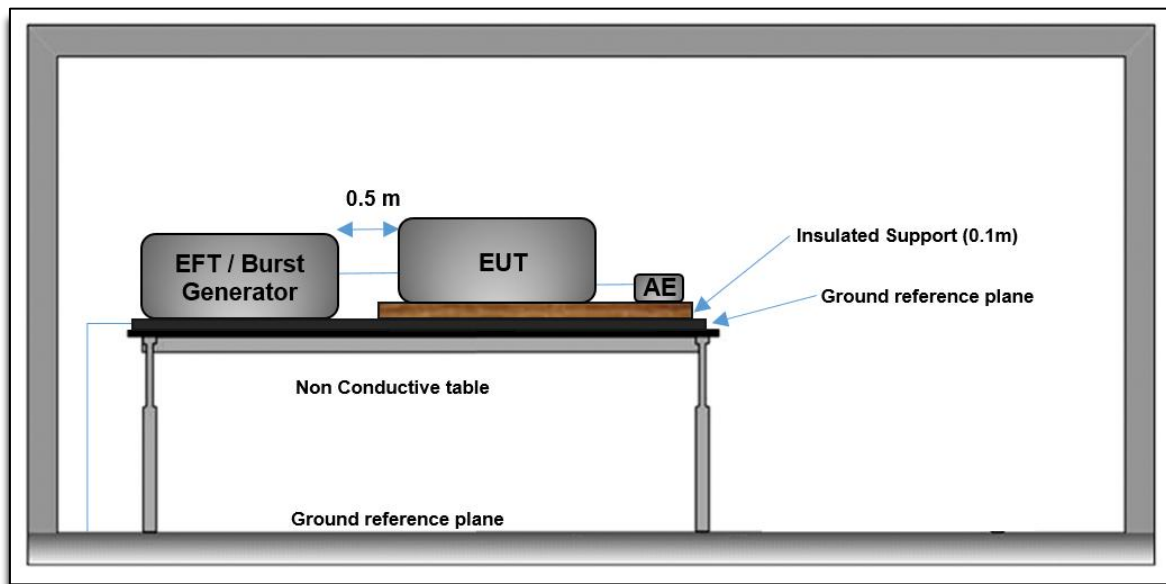

**Figure 12: Electrical Fast Transient Test Setup**





## Test Results:


Power Line: Coupling Path/Line	Test Level (KV)							
	+0.5	-0.5	+1	-1	+2	-2	+4	-4
L1	A	A	A	A	A	A	A	A
L2	A	A	A	A	A	A	A	A
L3	A	A	A	A	A	A	A	A
N	A	A	A	A	A	A	A	A
L-N	A	A	A	A	A	A	A	A
N-PE	A	A	A	A	A	A	A	A
L-PE	A	A	A	A	A	A	A	A
L1-L2-L3-N-PE	A	A	A	A	A	A	A	A

**Note:** Where L denotes all the Phase lines, ie: L1, L2 & L3.

Signal Lines	Test Level (KV)							
	+0.25	-0.25	+0.5	-0.5	+1	-1	+2	-2
Communication Cable	A	A	A	A	A	A	A	A

**Table 5: Electrical Fast Transient Test Results**

## Test Setup Photographs:

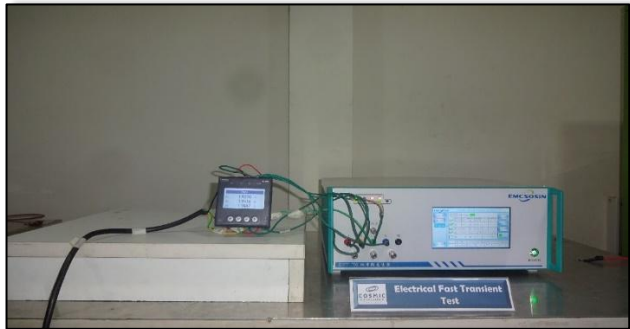

**EFT Test setup\_ Power Line test**



**EFT Test setup\_ Signal port test**

**Figure 13: Test Setup Photos**

**Test Result: PASS**



## Annexure E: Surge Test

### Common information:

Test Date : 18-09-2024  
Temperature : 25.5 ° C  
Humidity : 57.4 % RH

### Test Specification:

Reference Standard : IEC 61000-6-4:2018  
Test Standard : IEC 61000-4-5: 2017; Ed3.1  
Port tested : Power Port  
Type of pulse : 1.2/50  $\mu$  second  
No of surges : 5 surges/Phase angles  
Phase angles : 0°, 90°, 180° & 270°  
Test interval : 60 seconds  
Source impedance for  
common mode : 12  $\Omega$   
Source impedance for  
differential mode : 2  $\Omega$

### Test Equipment Used:

Sl. No.	Description	Make	Model No.	Serial No.	Cal Due
1.	Surge generator	EMCSOSIN	SUR T10	SX352201CC	05-06-2025

### **REMARK:**


(1) "N/A" denotes no model name, no serial no. or no calibration specified.



## Test Procedure:

1. The tabletop EUT was placed on table at 0.8meter height with the help of 0.1m insulation, Floor standing EUT was placed on insulation at 0.1meter height.
2. The surge pulse (1.2/50  $\mu$  seconds) surge was applied to the EUT power port and signal port using coupling and decoupling networks (CDN). Generator and CDN were grounded directly to the GRP.
3. The power cord between the EUT and the coupling/decoupling network does not exceed 2m in length. The interconnection line between the EUT and the coupling/ decoupling network shall not exceed 2m in length. The EUT was conducted the below specified test voltages for line to neutral and line to earth and neutral to earth, five positive pulses and five negative pulses of each at 0°, 90°, 180°, and 270° for AC power ports. The test levels were applied on the EUT with a 2 $\Omega$  generator source impedance for power supply terminals. The tests were done at repetition rate 1 per minute.
4. During the test performance of the EUT was monitored as per the criteria specified in the standard.

## Test Setup:

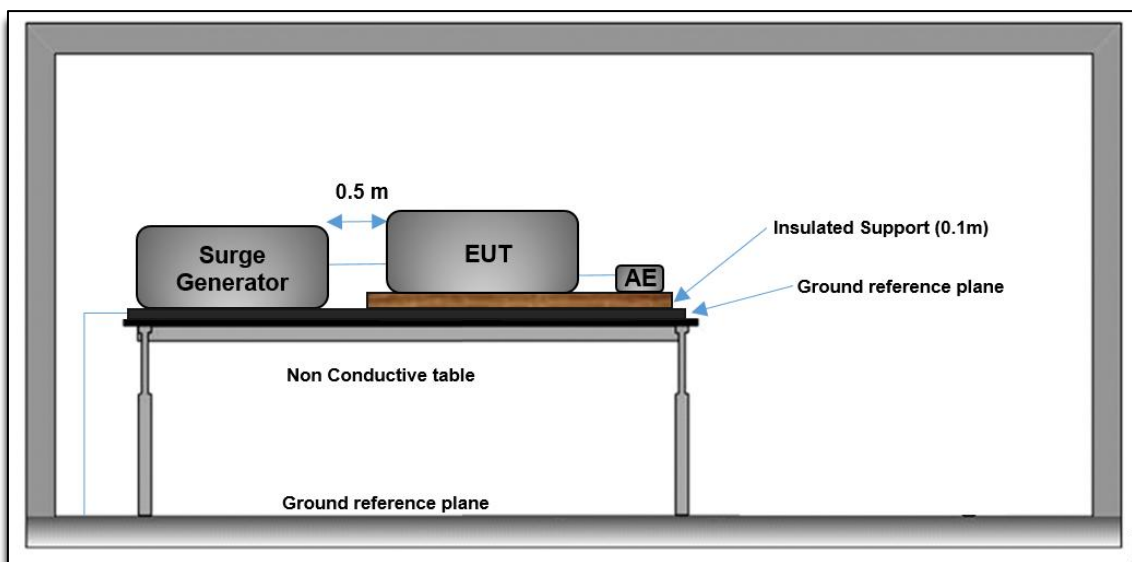

**Figure 14: Surge immunity Test Setup**





## Annexure F: Conducted Susceptibility Test (CS)

### Common information:

Test Date : 16-09-2024

Temperature : 24.9 ° C

Humidity : 58 % RH

### Test Specification:

Reference Standard : IEC 61000-6-4:2018

Test Standard : IEC 61000-4-6: 2013; Ed4.0

Frequency Range : 150kHz to 80MHz

Modulation : 1kHz Sine Wave, 80 %, AW Modulation

Injection method : CDN method

Port tested : Power port

Dwell Time : at least 3 s

Frequency step size : 1%

### Test Equipment Used:

	Description	Make	Model No.	Serial No.	Cal Due
1.	CDN	Compower	M325E	34090023	01-09-2025
2.	Power Amplifier	Rohde-Schwarz	BBA150	105654	NA
3.	Signal Generator	Rohde-Schwarz	SMB100A	182922	17-05-2026
4.	6dB attenuator	Srinar Communication	NA	NA	NA

### **REMARK:**


(1) "N/A" denotes no model name, no serial no. or no calibration specified.



## Test Procedure:

- A. The EUT was placed on insulation at 0,1 m  $\pm$  0,05 m meter height.
- B. Coupling and decoupling network (CDN) connected to the ground reference plane (GRP) with the distance of 0.1 m to 0.3 m from the EUT.
- C. The CDN was connected to the port intended to be tested and one CDN with 50  $\Omega$  termination was connected to another port. CDN was grounded to the GRP.
- D. The frequency range was swept from 150 kHz to 80 MHz, using the signal levels established during the setting process, and with the disturbance signal 80% amplitude modulated with a 1 kHz sine wave, pausing to adjust the RF signal level or to change coupling devices as necessary. Where the frequency was swept incrementally, the step size did not exceed 1% of the preceding frequency value. The dwell time of the amplitude modulated carrier at each frequency was not less than the time necessary for the EUT to be exercised and to respond, and was not less than 0.5 s.
- E. During the test performance of the EUT was monitored as per the criteria specified in the standard.

## Test Setup:

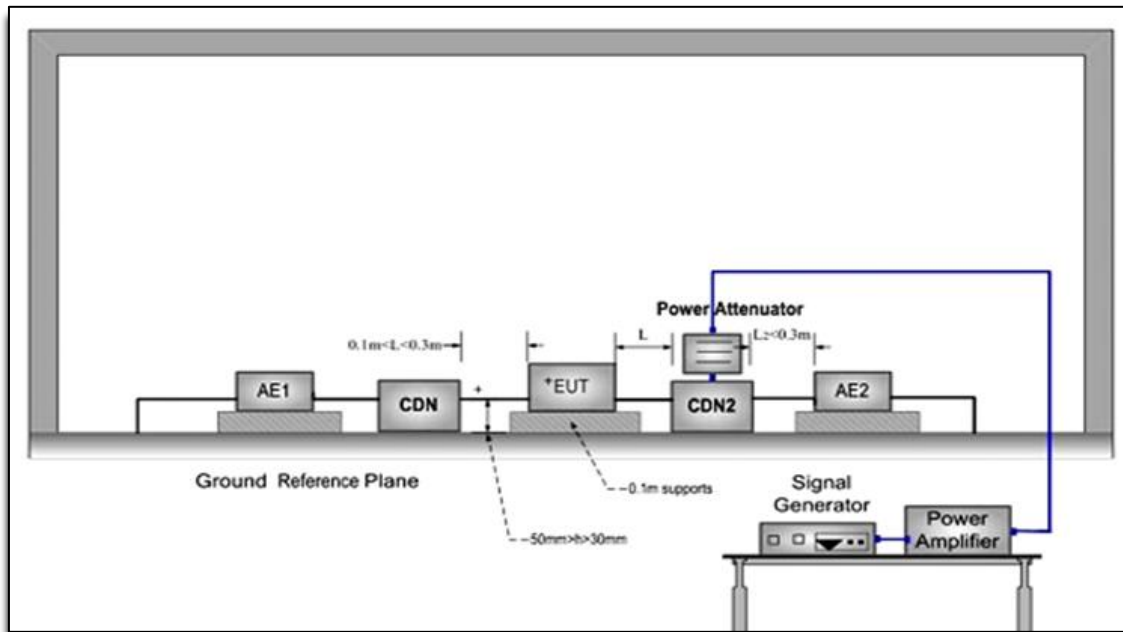

**Figure 16: Conducted Immunity Test Setup**



## Test Results:

Test Frequency	Test Level	Modulation	Power / Signal Port Name	Coupling Method:	Observation
150kHz to 80MHz	10 Vrms	AM	Power port	CDN	Criteria A

## Test Setup Photographs:



Figure 17: Test Setup Photos

**Test Result: PASS**



## Annexure G: Power Frequency Magnetic Field Test

### Common information:

Test Date : 16-09-2024

Temperature : 26.1 ° C

Humidity : 57.4 % RH

### Test Specification:

Reference Standard : IEC 61000-6-4:2018

Test Standard : IEC 61000-4-8: 2009

Coil orientations : X, Y & Z

Test duration for short duration : 1 sec for each orientation.

Test duration of Continuous field : 60 sec for each orientation

### Test Equipment Used:

Sl. No.	Description	Make	Model No.	Serial No.	Cal Due
1.	Power frequency magnetic field generator	EMC SOSIN	PFM 1200	SX282206G1	14-02-2025

### **REMARK:**

(1) "N/A" denotes no model name, no serial no. or no calibration specified.






## Test Procedure:

1. Tabletop EUT was placed on  $0,5 \pm 0,05$ -meter insulated table. Floor standing EUT was placed on GRP with the help of 0.1-meter insulation.
2. The test generator was directly grounded on the ground reference plane and connected to the magnetic field induction coil through a high voltage cable.
3. The current and frequency of the source was set according to the requirement specified in test plan.
4. The AC current generated from the generator was given through the magnetic induction coil & power frequency magnetic field (PFMF) was generated through the coil
5. The EUT was subjected to the test magnetic field by using the induction coil of standard dimensions ( $1\text{m} \times 1\text{m}$ ) by the immersion method.
6. EUT and all cables were exposed to the magnetic field.
7. The coil was placed all the 4 sides of the EUT for proximity method. The induction coil was rotated 90 degree in order to expose all sides of the EUT to the magnetic field with different orientations. The test was repeated by moving and shifting the magnetic field coil in order to test all sides of the EUT.
8. The EUT placed X axis, Y axis, Z axis and immersed to the magnetic field induction coil.
9. During the test performance of the EUT was monitored as per the criteria specified in the standard

## Test Setup:

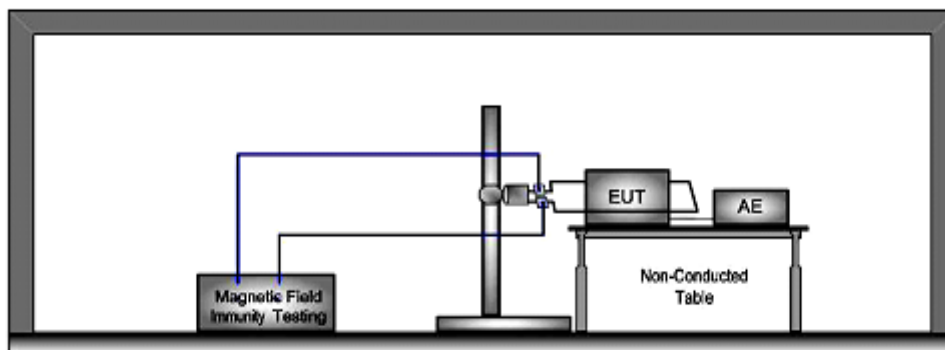

**Figure 18: PFMF Test Setup**



## Test Results:

Test Level	EUT Face	Result / Observations
1 A/m	X	Criteria A
	Y	Criteria A
	Z	Criteria A

**Table 7: PFMF Test Results**



## Test Setup Photographs:



Test setup photograph of X axis



Test setup photograph of Y axis



Test setup photograph of Z axis

**Figure 19: Test Setup Photos**

**Test Result: PASS**



## Annexure H: Voltage Dips and Short Interruptions Test

### Common information:

Test Date : 16-09-2024

Temperature : 24.9 ° C

Humidity : 57.6 % RH

### Test Specification:

Reference Standard : IEC 61000-6-4:2018

Test Standard : IEC 61000-4-11: 2020; Ed3.0

Phase angle : 0° to 360° at the step of 45°

No. of Test Repetitions : 3

### Test Equipment Used:

Sl. No.	Description	Make	Model No.	Serial No.	Cal Due
1.	Voltage Dips Generator	EMCSOSIN	VDT T20	SX342201D5	14-02-2025

### **REMARK:**


(1) "N/A" denotes no model name, no serial no. or no calibration specified.



## Test Procedure:

1. Tabletop EUT was placed on 0,8-meter insulated table. Floor standing EUT was placed on GRP with the help of 0.1-meter insulation.
2. The power supply to the EUT was fed by compact NX generator.
3. The EUT was configured and connected to satisfy its functional requirements.
4. The EUT was subjected to voltage dips and short interruption according to the specification in standard.
5. Each test sequence with the below mentioned test level and duration was repeated 3 times with a minimum interval of 10 seconds.
6. Voltage dips test was done by synchronizing the dips at 0° to 360° phase angle in 45° steps. Interruption test was synchronized at 0°.
7. During the test performance of the EUT was monitored as per the criteria specified in the standard.

## Test Setup:

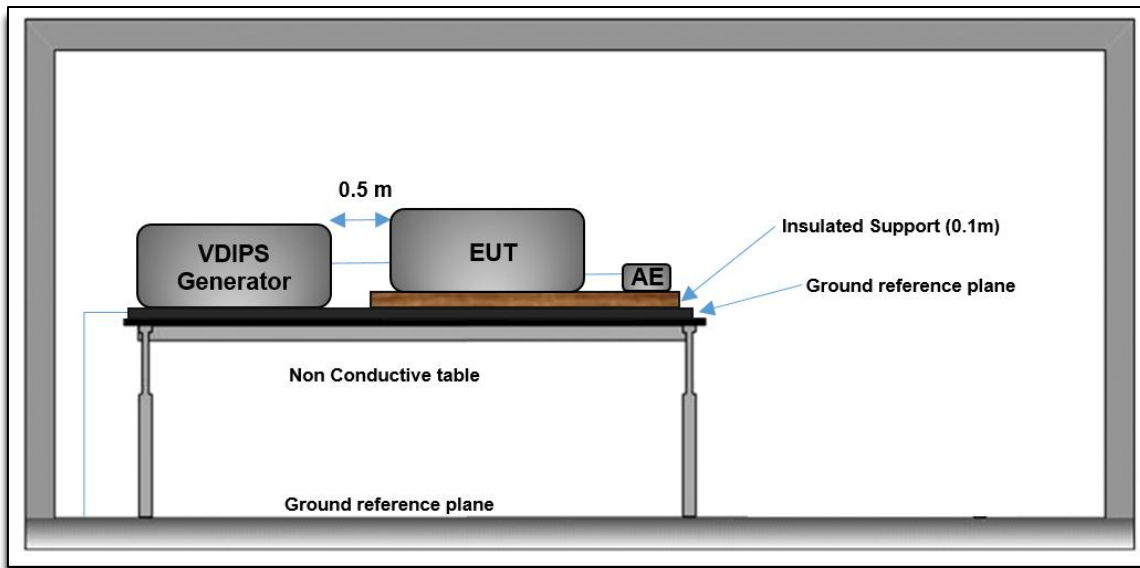

**Figure 20: Voltage Dips and Short Interruption Test Setup**



## Test Results:

Test Level (%)	Reduction (%)	Duration (ms)	Cycles	Phase angle	No of dips	Observations
<b>Voltage Dips</b>						
0%	0V	10ms	0.5	45° 90° 135°	3	No degradation occurred
0%	0V	20ms	1	180° 225° 270°	3	No degradation occurred
70%	161V	500ms	25	315° 360°	3	No degradation occurred
<b>Short Interruptions</b>						
0%	0V	5000ms	250	45° 90° 135° 180° 225° 270° 315° 360°	3	No degradation occurred

**Table 8: Voltage Dips and Short Interruption Test Results**



## Test Setup Photographs:



Figure 21: Test Setup Photos

Test Result: **PASS**

# EMC TEST REPORT



## DISCLAIMER

1. The Released Test Report/s relates ONLY to the specific sample/s tested under the stated conditions and is issued in good faith. It is the Client / Customer's responsibility to ensure that additional production units of the tested sample/s are manufactured with identical electrical, mechanical and software/firmware components so as to meet the same specifications and quality as the tested sample/s.
2. The Test Reports are issued free of any alterations or additions. Any corrections/erasures invalidate the Test Reports Cosmic Compliance Test Lab does not accept any liability whatsoever for the tampering or any unlawful or inadvertent alteration of documents that have been handed over to the Client / Customer. Any anomaly /discrepancy in the Test report should be brought to the notice of Cosmic Compliance Test Lab within 1 (One) Month from the date of issue.
3. Test Reports /Certificates or/and any associated attachments shall NOT be copied/reproduced, except IN FULL, without the prior written consent of Cosmic Compliance Test Lab.
4. Every reasonable care is taken to ensure that the Test Reports / Certificates are accurate. Cosmic Compliance Test Lab does not accept any responsibility for any consequences arising from the further use of these Test Reports / Certificates or the conclusions and /or opinions drawn from the results of these Tests or investigations by third parties.
5. While every effort is taken by Cosmic Compliance Test Lab to ensure that Test Reports are presented to the Customer / Client within a reasonable time, Cosmic Compliance Test Lab does not guarantee any turnaround time nor will it be responsible for any late delivery of services because of circumstances beyond its control. In no event will Cosmic Compliance Test Lab be liable for damages of any kind, including, without limitation, direct, incidental or consequential damages, including, but not limited to, damages for lost profits, business interruption and loss of programs or information arising out of the use of or inability to use Cosmic Compliance Test Lab Test results and / or because of a delay in Cosmic Compliance Test Lab providing Test results, or in the Test results or claims attributable to errors, omissions or other inaccuracies in the interpretations thereof. The maximum monetary amount that Cosmic Compliance Test Lab would be liable for is reimbursement for the cost of the Tests conducted for testing services received by Customer / Client. Parties acknowledge and confirm that the Test report certification doesn't create a warranty that the product(s) tested and certified under this report are better than those not certified.
6. The Customer / Client agrees to indemnify, defend and hold Cosmic Compliance Test Lab harmless from and against all losses, expenses, damages, and costs, including attorney fees, arising out of any litigation or relating to any misuse by the Customer / Client of the content and / or services provided by Cosmic Compliance Test Lab.
7. Any possible infringement of any patent rights of formulations or processes or any other patent rights are the sole responsibility and liability of the Client / Customer.
8. All services rendered by Cosmic Compliance Test Lab will be treated as strictly Confidential.
9. Cosmic Compliance Test Lab will respond to clarifications requested by the Client / Customer for a maximum period of 1 (One) Month from the date of receipt by the Client / Customer. Samples will not be retained Cosmic Compliance Test Lab after testing is completed. Soft copies of all Test Reports / Certificates will be retained by Cosmic Compliance Test Lab for a maximum period of 3 (Three) Years from the date of issuance of Test Report unless otherwise agreed to by and between the Client / Customer and Cosmic Compliance Test Lab.
10. By receiving this report Cosmic Compliance Test Lab, the Client / Customer agrees to the terms and conditions of Cosmic Compliance Test Lab Laboratory and this Disclaimer.

**End of Test Report**

